Firehouse Alarm and Emergency Signaling Device - Specifications






Firehouse Base Diagram



Firehouse

DimensionsHeight:44.00" (1117.60 mm)Width:9.500" (241.30 mm)Depth:9.875" (250.83 mm)

Approximate Weight: 20-26 lbs. (9.1-11.8 kg)



UL FILE # S24715

General Specifications for Firehouse Alarm & Emergency Signaling Device

All Power Pedestals Must Meet the Following:

Part I. General:

1.1 General Requirements:

- A. Shall be tested and certified to be in compliance with with UL2017 entitled "alarm and emergency signaling equipment."
- B. If a laboratory other than U.L. is used that laboratory must certify, in writing, that the alarm and emergency signaling equipment has been tested and meets all of the requirements of ANSI/UL 2017.
- C. Shall be certified to meet all sections of NFPA 303 DTD "2011 Marinas and Boatyards."
- D. Shall have the capability to house either a 10 lb. or 20 lb. A, B, and C fire extinguisher.
- E. Shall have downward, indirect illumination indicating the device is functioning properly.

Part II. Products:

2.1 Acceptable Manufacturers - Type SM (Self Monitoring) Emergency Signaling Device:

A. Dock Boxes Unlimited, Inc. Irving, TX 75038 Toll Free: 1-800-559-4269

2.2 Type SM (Self Monitoring) Emergency Signaling Device - General Specification

- A. Main Housing:
 - a. The housing shall be constructed of 20 gauge, 316L low carbon stainless steel and shall be coated with UV-resistant polyester resin over a powder coating. It shall be UL listed as a type 3R weatherproof enclosure.
 - b. The housing shall have the capacity to house a 10 lb. or 20 lb. A, B, and C fire extinguisher.



B. <u>Access Door</u>:


- a. The access door shall be hinged with a stainless steel latch.
- b. The door shall have a clear access window made of engineered resin.
- c. Access to the fire extinguisher shall not require breakage of any part of the unit.
- C. Lighting Assembly / Housing:
 - a. The lighting top housing shall be constructed of 1/8" thick injection molded heavy resin material and shall be coated with a water based acrylic polymer. It shall be UL listed as a type 3R weatherproof enclosure.
 - b. STANDARD Each pedestal shall be equipped with a non-metered light. The lighting assembly shall include one LED compact fluorescent light, that is protected by a 0.5 amp, in-line fuse.
 - c. OPTION Each pedestal shall be equipped with a non-metered LED light, that is protected by a 0.5 amp, in-line fuse. 14-watt light
- D. <u>Wiring:</u>
 - a. The alarm and emergency signaling device shall be completely pre-wired at the factory to the load side of the terminal strip.
 - b. All load copper wiring shall be of high stranding and tin plated to resist corrosion.
 - c. The maximum size of the line wiring shall be #6 AWG.
- E. <u>Alarm System Visual High-Intensity Strobe</u>:
 - a. The audible alarm system shall have an output of 68 dBA, and a strobe light shall simultaneously activate to indicate the removal of the life ring and / or fire extinguisher.
- F. Grounding:
 - a. All exposed metallic parts must have an integral ground that is a part of the equipment grounding system.
- G. Fire Extinguisher (Optional):
 - a. Each cabinet shall be equipped with a 10 lb. or 20 lb. ABC fire extinguisher.
- H. Life Ring (Optional):
 - a. Each cabinet shall be equipped with a 30" life ring and provisions to sound an alarm system when the life ring is removed.

(END OF SECTION)


Firehouse Alarm and Emergency Signaling Device - Specifications




Product Features

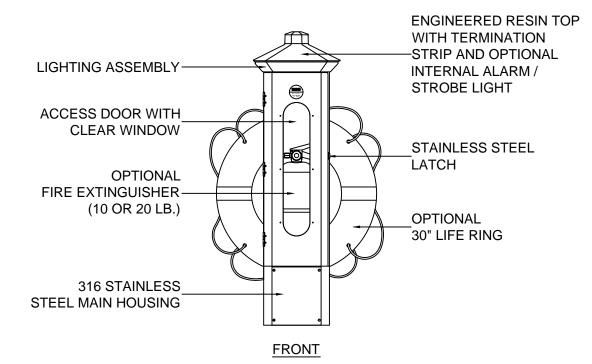

Dimensions

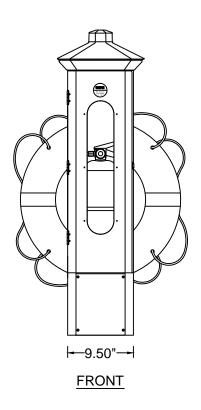


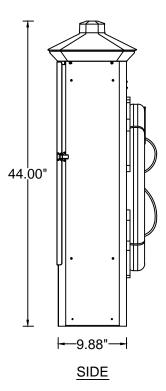

Firehouse Alarm and Emergency Signaling Device - Specifications



Base Dimensions

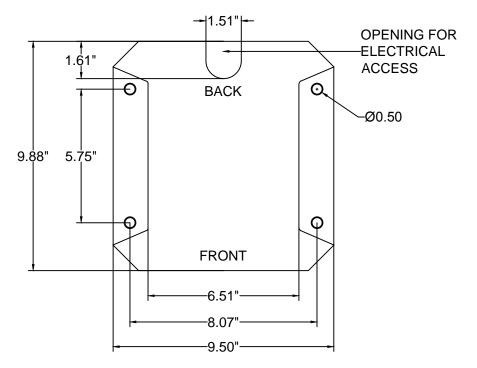

Wiring Diagram - Terminal Block

